

Application Of Norika Air Testing Products For Low Pressure Test

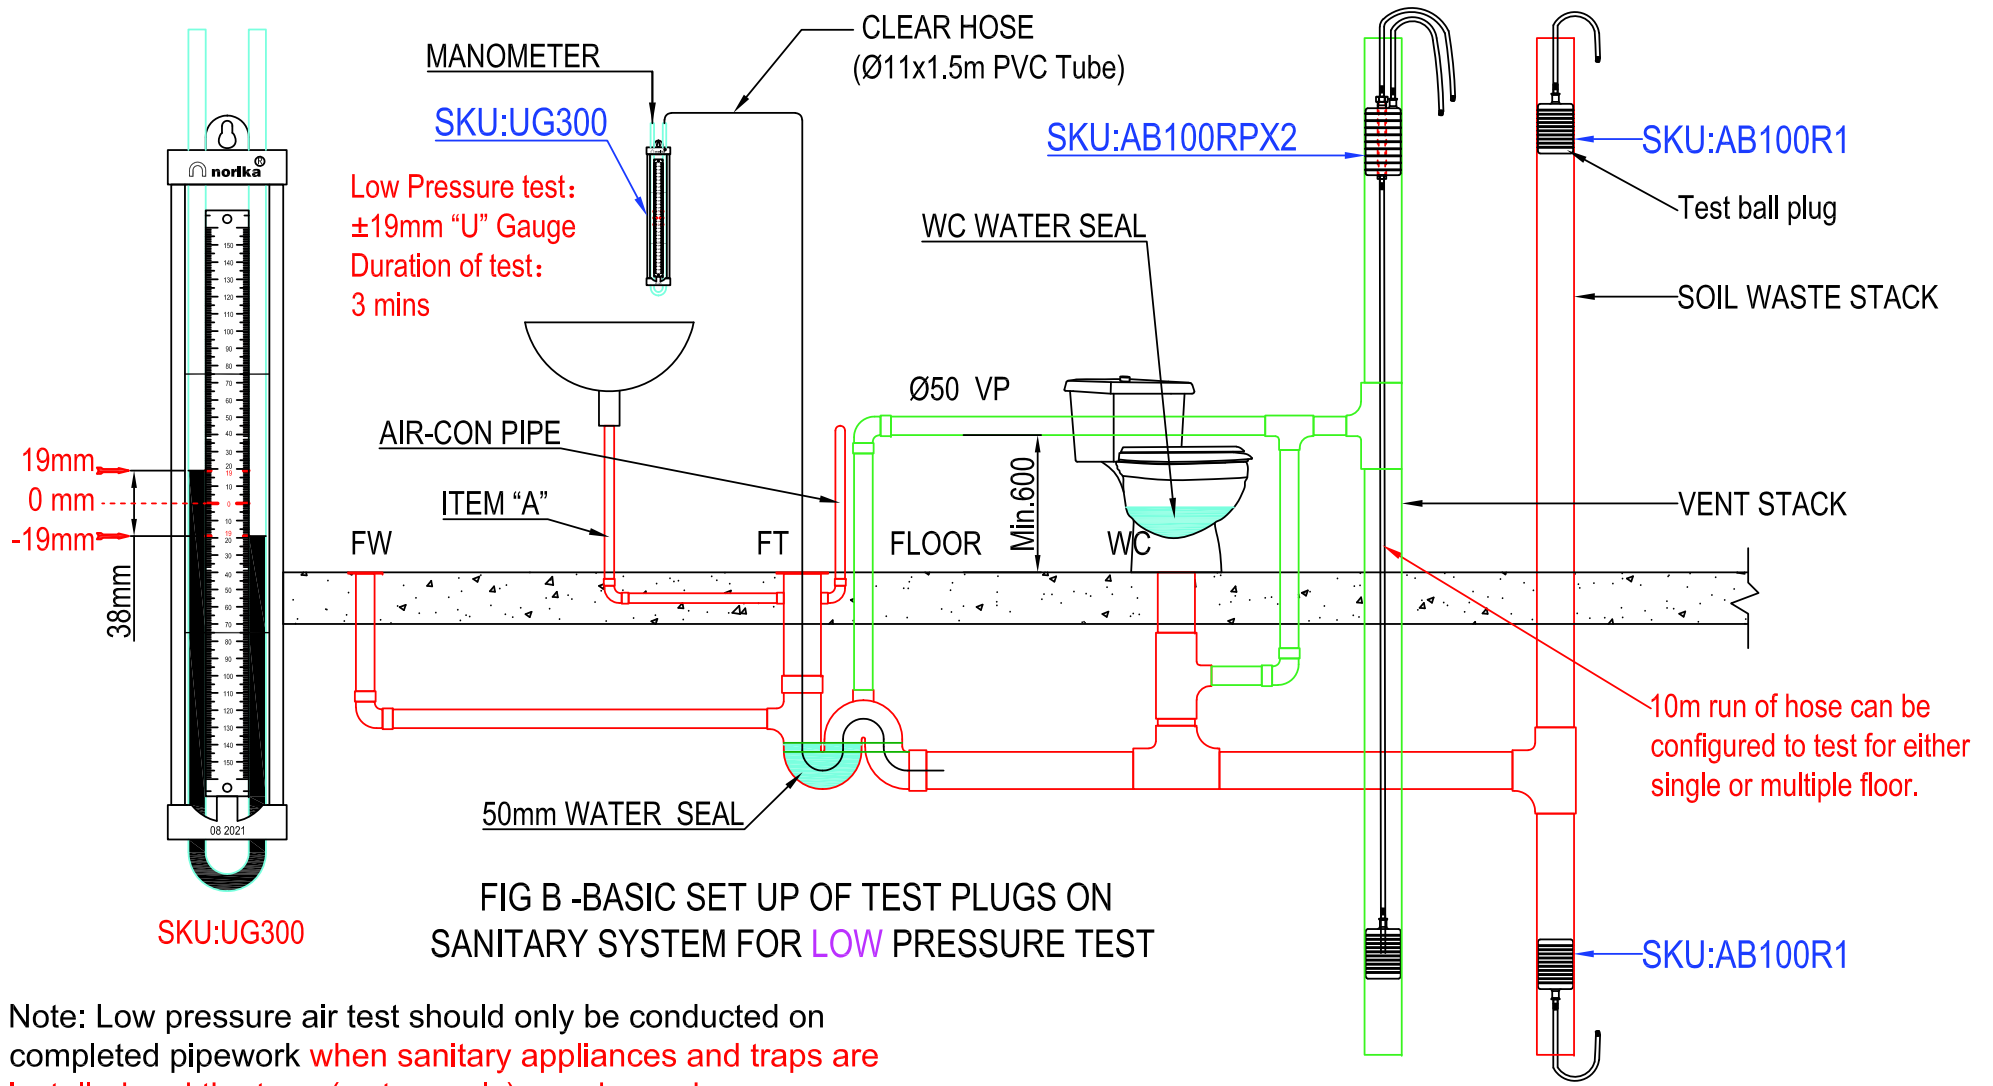


FIG B -BASIC SET UP OF TEST PLUGS ON SANITARY SYSTEM FOR LOW PRESSURE TEST

Note: Low pressure air test should only be conducted on completed pipework when sanitary appliances and traps are installed and the traps(water seals) are charged.