

CENTRE LOCKING DRAIN TESTING PLUGS


(42mm – 375mm)




TP0042-TP0150



TP0200-TP0350

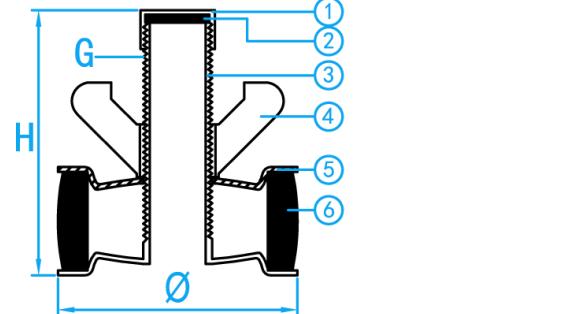

CROSS SECTION VIEW

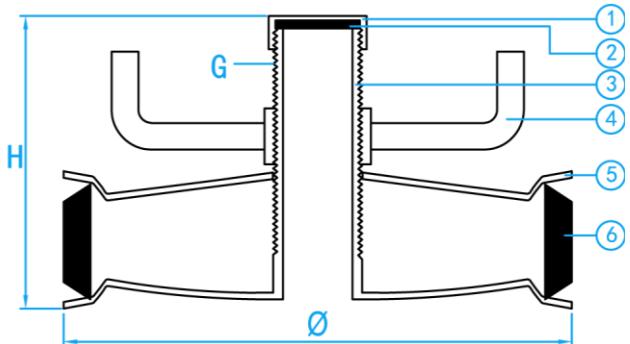

CROSS SECTION VIEW

OPERATING PROCEDURE

- 1 Select the correct size of the plug to suit the internal diameter of the pipe.
- 2 Remove any grease or foreign material from installation point.
- 3 Ensure no dirt is trapped between seal of plug and plates.
- 4 Ensure plug is inserted square to pipe wall.
- 5 Ensure wing nut and sealing cap are fully tightened.

STANDARD SPECIFICATIONS

SKU	SIZE (mm)	G (inch)	H (mm)	Ø (mm)	RANGE MIN/MAX (mm)	WEIGHT (kg)
TP0042	42	1/2"	77	37.0	37-48	0.180
TP0050	50	1/2"	77	49.5	50-60	0.190
TP0065	65	1/2"	77	61.5	62-75	0.240
TP0080	80	1/2"	77	75.0	75-85	0.280
TP0100	100	1/2"	77	95.5	96-110	0.390
TP0125	125	1/2"	77	123.0	127-138	0.540
TP0150	150	1/2"	77	143.0	143-163	0.805
TP0200	200	1"	99	190.0	191-211	1.835
TP0225	225	1"	99	211.0	216-235	2.305
TP0250	250	1"	99	240.0	246-260	2.800
TP0300	300	1"	99	285.0	302-314	3.950
TP0350	350	1"	150	335.0	340-375	5.920